

Office Application

An office can be controlled via the Lightcloud control system in various ways.

1. For ultimate flexibility and controllability, an LC Controller can be added to each fixture on-board. This will allow for individual control of each luminaire, and eliminates the need for 0-10V daisy chained control wiring.In this case, the office has four (4) individual zones.

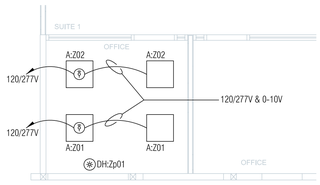

2. Two Zones could be provided by adding an LC Controller on-board two of the fixtures then daisy chaining the 120/277V and 0-10V Control wiring to the second fixture. This would be a good choice when using the Daylight Harvester. In this case, the two fixtures adjacent to the windows could be one Zone, and the other two can be a second zone.

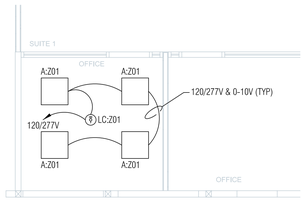

3. One LC Controller can control up to 15 Amps of load. In this scenario, we are using one LC Controller to control all the fixtures in the office. This will minimize device quantities, but the 0-10V control wiring will need to be daisy chained to each fixture as well as power wiring if dimming is desired.

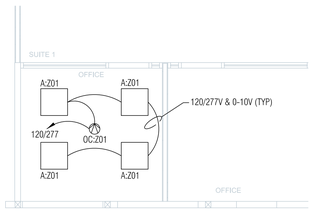

4. One OC can act just line and LC Controller, and can control up to 15 Amps of load. In this scenario, we are using one OC to control all the fixtures in the office. The OC can be programmed as both Occupancy and Vacancy Sensing. This will minimize device quantities, but the 0-10V control wiring will need to be daisy chained to each fixture as well as power wiring if dimming is desired.

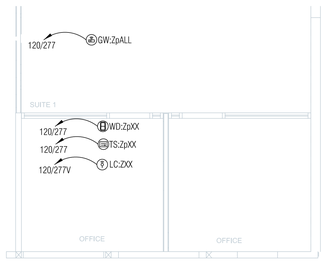

5. Local controls can be provided in offices. The WD can be programmed to operate up to four functions. The TS can be programmed to control an unlimited number of functions and scenes. Each device requires 120/277V, but no other wiring.
6. Some Codes require switching receptacles based upon occupancy and/or time of day scheduling. An LC Controller used in conjunction with a Contactor can be used to accomplish this.
7. All Lightcloud installations will require a Gateway. The GW requires 120/277V, but no other wiring. The GW can communicate with up to 200 LC Devices. Additional GW's will be required for higher quantities.

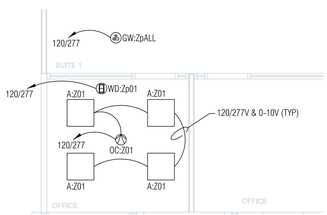

8. For this Typical Office scenario, control could be Manual-On, Auto Off with dimming and overall time of day scheduling.

(1)LCGATEWAY
(1)LCSENSE
(1)LCDIMMERW

Trade Net Cost: $2600

Lightcloud Zone Notation

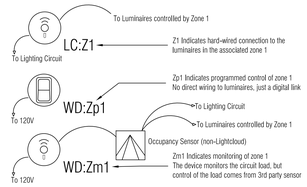

Lightcloud Symbol Key

- GW - Gateway (1 2 4 5 6 7)
- LC - Controller (1 2 3 4)
- OC - Occupancy Ceiling Sensor (1 2 3 4 9)
- VC - Vacancy Ceiling Sensor (1 2 3 4 5 9)
- RAB - Hard-wired Sensor (non-Lightcloud)
  Indicates non-Lightcloud wired control device. Consult Lightcloud.com for assistance with integration into a Lightcloud system..
- DH - Daylight Harvester (open loop) (1 2 9)
- WD - Wall Box Dimmer/Switch (1 2 4 8 9)
- TS - Touch Screen Wall Display (1 2 4 9)

Lightcloud Notes

1. Wireless ranges vary greatly depending on which materials stand in the way between two devices. For line of sight applications, max device distance is 250 feet. For interior applications, 30 feet between devices is good practice.
2. Avoid placing devices near microwaves, motors, elevator mech rooms or radio antennas to minimize interference with the wireless signal.
3. Neutral wire of the load must be connected to the white-red sense wire in order to measure power use. If the Switched Neutral line cannot be used, it should be tied to the regular neutral wires (i.e. all neutral wires joined).
4. Designed to be hard-wired to AC power. An external readily accessible disconnect device, such as a circuit breaker, is required.
5. Contact RAB only for replacement of Gateway LI-Ion battery. CAUTION! RISK OF EXPLOSION IF BATTERY IS REPLACED BY AN INCORRECT TYPE.
6. Install in location with good cellular signal. Locations with significant concrete and brick construction, or underground locations, are not recommended. DO NOT INSTALL INSIDE METAL ENCLOSURE.
7. Install in dry or non-condensing damp environment only.
8. Must be installed in UL-approved single gang wall-box enclosure. Use only solid copper wire.
9. Indoor use only.
10. Changes or modifications to Lightcloud equipment not expressly approved by RAB Lighting, Inc. may void the user's authority to operate this equipment.

RAB LIGHTING
170 Ludlow Avenue, Northvale, NJ 07647
888 722-1000 • RABWEB.COM

CLIENT:

XXX

REV	DATE	DESCRIPTION	BY
###	MM.DD.YY	PROJECT AWARD DATE	XXX

PROJECT:

XXX

SCALE: AS SHOWN
DATE: XXXXX
CASE NUMBER: XXXXX
DESIGNED BY: CBarnes, LC
DRAWN / CHK BY: SFillion, LC

TITLE:
Lightcloud Application Information - Private Office Example

DRAWING NUMBER:
EL-7.1

ADVISORY DRAWING SET
NOT FOR CONSTRUCTION

All drawings and representations of the lighting design intent are the copyright property of RAB Lighting, Inc. Reproduction of any and all drawings, specifications, related documents, and design illustrations, in whole or in part, is strictly forbidden without written permission. The Energy Analysis, Visual Simulations, Lighting Analysis, Control Intent documentation, and/or ezLayout, (representing "Lightcloud Documentation") provided by the RAB Lighting Inc. ("RAB") represent an anticipated prediction of lighting system performance based upon design and control parameters and information supplied by others. These design parameters and information provided by others have not been field verified by RAB and therefore actual measured results may vary from the actual field conditions. RAB recommends that design parameters and other information be field verified to reduce variation. RAB neither warranties, either implied or stated with regard to actual measured light levels or energy consumption levels as compared to those illustrated by the Lightcloud Documentation. Additionally the appropriateness, completeness or suitability of the Lightcloud Documentation intent as compliant with any applicable regulatory code requirements with the exception of those specifically stated on drawings created and submitted by RAB. The Lightcloud Documentation is issued, in whole or in part, as advisory documents for informational purposes and is not intended for construction nor as being part of a project's construction documentation package.

C:\Users\catherine.barnes\Desktop\For Rob Riley.dwg

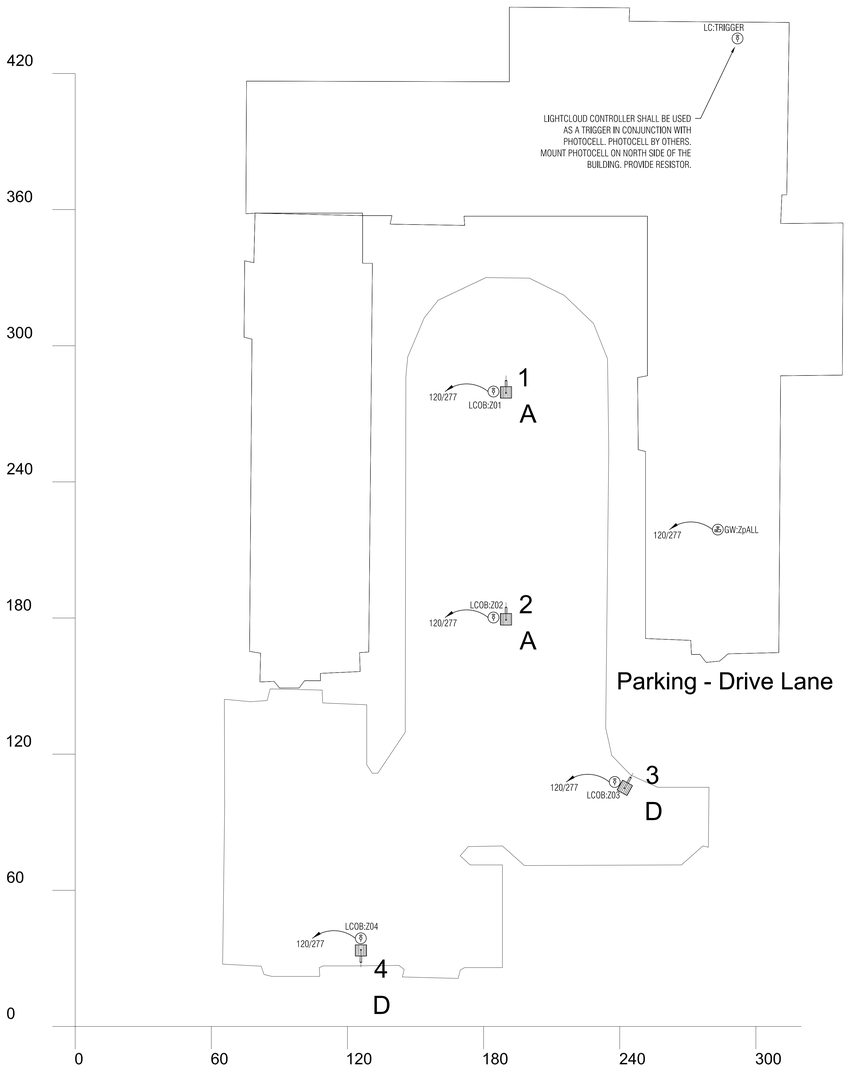

Parking Lot Application

A Parking Lot can be controlled via the Lightcloud control system in various ways.

1. The Lightcloud Lighting Control System can control exterior / site lighting via time of day scheduling. Photocells , Motion Sensors, and any variety of additional third party devices can be used in conjunction with an LC Controller to allow for additional control inputs. When an LC Controller is used in this manner as a trigger, a small resistor is required, RESLC/120V.

2. For existing parking lots there are a few ways to add the Lightcloud control system. For these cases, we would assume that we are interested in ON/OFF only since adding 0-10V control wiring is probably not existing, and probably it would be cost prohibitive to add it to an existing parking lot.

   A. Intercept exterior lighting circuits at the panelboard and install the LC Controller ahead of the site lighting loads. Ensure loads are less than 15A.
   B. Add one LC Controller at each pole/fixture. LC Controllers are rated for outdoor use. Depending on site topography, pole locations and vegetation repeaters may be required to ensure adequate signal strength.

3. For a new parking lot, we have the capability to use the dimming feature to realize energy savings. Control strategies could include dimming the lights to a low output on a time of day basis, with a motion sense override.

   A. The most flexible solution for a new parking lot is to add one LC Controller per fixture. This allows for the installation of power wiring only to each pole, no daisy-chaining of control wiring will be necessary.
   B. Exterior fixtrues could be zoned in a similar fashion as interior fixtures. For example, for a front row of fixtures at a car dealership, an LC Controller can be added to the first fixture on the circuit, then the power and control wiring can be daisy chained to the rest of the fixtures in the row. This allows the entire front row to act as one Zone.
   C. The least flexible way to control a parking lot would be to add as many fixtures to a LC Controller as possible, up to 15A load. Power and Control wiring would need to be daisy chained.

3. For the application on the left, assume that this is a new installation and the fixtures are by others, but have 0-10V dimming. The intent would be to add (1)LC Controller on-board each fixture, then an LC Contoller and resistor to allow for photocontrol, then the Gateway. This will allow for time of day control with photocell input. Coordinate installation of Gateway to ensure proper signal strength. Provide any repeaters as required for a properly functioning system.

   (1)LCGATEWAY
   (5)LCCONTROL20/D10
   (1)RESLC/120

   Trade Net Cost: $3000

Lightcloud Symbol Key

- GW - Gateway ①②④⑤⑥⑦
- LC - Controller ①②③④
- OC - Occupancy Ceiling Sensor ①②③④⑨
- VC - Vacancy Ceiling Sensor ①②③④⑨
- RAB - Hard-wired Sensor (non-Lightcloud)
  Indicates non-Lightcloud wired control device. Consult Lightcloud.com for assistance with integration into a Lightcloud system..
- DH - Daylight Harvester (open loop) ①②⑨
- WD - Wall Box Dimmer/Switch ①②④⑧⑨
- TS - Touch Screen Wall Display ①②④⑨

Lightcloud Zone Notation

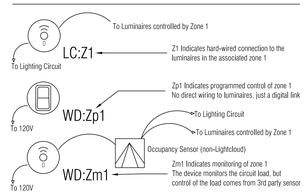

Lightcloud Notes

① Wireless ranges vary greatly depending on which materials stand in the way between two devices. For line of sight applications, max device distance is 250 feet. For interior applications, 30 feet between devices is good practice.

② Avoid placing devices near microwaves, motors, elevator mech rooms or radio antennas to minimize interference with the wireless signal.

③ Neutral wire of the load must be connected to the white-red sense wire in order to measure power use. If the Switched Neutral line cannot be used, it should be tied to the regular neutral wires (i.e. all neutral wires joined).

④ Designed to be hard-wired to AC power. An external readily accessible disconnect device, such as a circuit breaker, is required.

⑤ Contact RAB only for replacement of Gateway LI-ion battery. CAUTION! RISK OF EXPLOSION IF BATTERY IS REPLACED BY AN INCORRECT TYPE.

⑥ Install in location with good cellular signal. Locations with significant concrete and brick construction, or underground locations, are not recommended. DO NOT INSTALL INSIDE METAL ENCLOSURE.

⑦ Install in dry or non-condensing damp environment only.

⑧ Must be installed in UL-approved single gang wall-box enclosure. Use only solid copper wire.

⑨ Indoor use only.

⑩ Changes or modifications to Lightcloud equipment not expressly approved by RAB Lighting, Inc. may void the user's authority to operate this equipment.

ADVISORY DRAWING SET
NOT FOR CONSTRUCTION

All drawings and representations of the lighting design intent are the copyright property of RAB Lighting, Inc. Reproduction of any and all drawings, specifications, related documents, and design illustrations, in whole or in part, is strictly forbidden without written permission. The Energy Analysis, Visual Simulations, Lighting Analysis, Control Intent documentation, and/or ezLayout, (representing "Lightcloud Documentation") provided by the RAB Lighting Inc. ("RAB") represent an anticipated prediction of lighting system performance based upon design and control parameters and information supplied by others. These design parameters and information provided by others have not been field verified by RAB and therefore actual measured results may vary from the actual field conditions. RAB recommends that design parameters and other information be field verified to reduce variation. RAB neither warranties, either implied or stated with regard to actual measured light levels or energy consumption levels as compared to those illustrated by the Lightcloud Documentation. Additionally the appropriateness, completeness or suitability of the Lightcloud Documentation intent as compliant with any applicable regulatory code requirements with the exception of those specifically stated on drawings created and submitted by RAB. The Lightcloud Documentation is issued, in whole or in part, as advisory documents for informational purposes and is not intended for construction nor as being part of a project's construction documentation package.

RAB LIGHTING
170 Ludlow Avenue, Northvale, NJ 07647
888 722-1000 • RABWEB.COM

CLIENT:

XXX

REV	DATE	DESCRIPTION	BY
###	MM.DD.YY	PROJECT AWARD DATE	XXX

PROJECT:

XXX

SCALE: AS SHOWN
DATE: X
CASE NUMBER: X
DESIGNED BY: CBarnes, LC
DRAWN / CHK BY: SFillion, LC

TITLE:

Lightcloud Application Information - Exterior Parking Example

DRAWING NUMBER:

EL-7.2

C:\Users\catherine.barnes\Desktop\For Rob Rilley.dwg

High Bay Storage Application

A Storage Area can be controlled via the Lightcloud control system in various ways.

1. For ultimate flexibility and controllability, an LC Controller can be added to each fixture on-board. This will allow for individual control of each luminaire, and eliminates the need for 0-10V daisy chained control wiring. The same can be said for an OC Sensor. We can provide the /LCS option on each fixture to sense occupancy, and we will only need the power wiring. In this case, the storage area has twenty (20) individual zones. Other devices would likely be requested such as local wall controls or daylight harvesting.

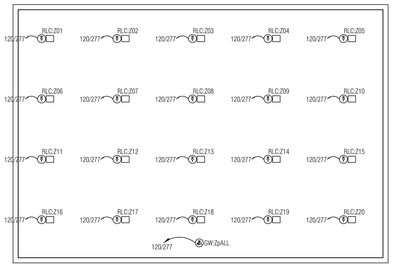

2. Four Zones could be provided by adding an LC Controller (or LCS High Bay Occupancy Sensor) on-board four of the fixtures then daisy chaining the 120/277V and 0-10V Control wiring to the subsequent fixtures in that zone. This would be a good choice if there are racks in the storage area, or when there might be skylights for daylighting. In this case, each row is acting like one zone. Zones could be configured alternatively based upon clients needs. Other devices would likely be requested such as wall controls.

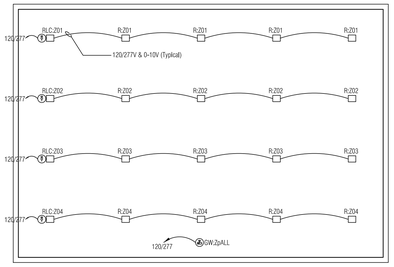

3. This scenario is based upon a full coverage occupant sensing system approach. Based on a 20'AFF Mounting Height, the LCHBSENSE15/D10 has a 33' coverage pattern, so for this storage area (6)sensors would be required. Each sensor can control a Zone, so in this case there *could* be up to (6)Zones. For this example, we are showing (4)four zones only. The (2)two sensors that do not control a zone are simply considered "Programmed" only, as designated by the lowercase 'p' in the naming convention. Based upon client needs and wishes other devices would likely need to be provided such as wall controls and daylight sensors.

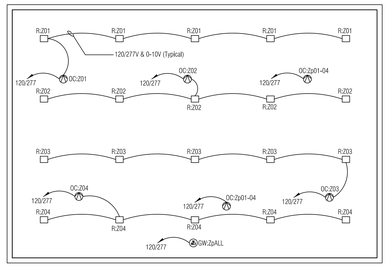

4. This scenario uses the least amount of devices possible. One LC Controller can accommodate all up to a 15A load so if we assume that these fixtures are RAIL150's and they are fed with 277V, we can control all luminaires as one zone. The LC Controller can be mounted anywhere or onboard the first fixture. This will minimize device quantities, but the 0-10V control wiring will need to be daisy chained to each fixture as well as power wiring if dimming is desired.

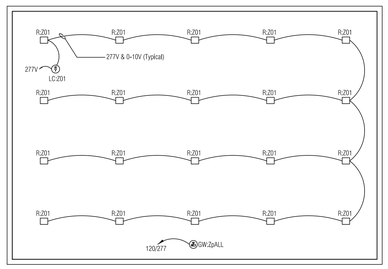

8. For this Typical Storage Area, each RAIL fixture will have LC on-board. Assume a Wall Dimmer by each of the (2)Man Doors. Add a High Bay Occupant Sensor above each Man Door as well to ensure automatic override after hours.

(1)LCGATEWAY
(20)RAIL150W/D10/LC
(2)LCDIMMERW
(2)LCHBSENSE15/D10

Trade Net Cost: $11,275

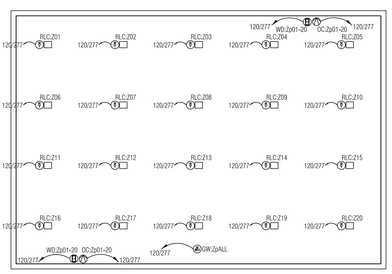

Lightcloud Zone Notation

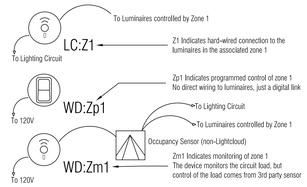

Lightcloud Symbol Key

- GW - Gateway (1 2 4 5 6 7)
- LC - Controller (1 2 3 4)
- OC - Occupancy Ceiling Sensor (1 2 3 4 8)
- VC - Vacancy Ceiling Sensor (1 2 3 4 8)
- RAB - Hard-wired Sensor (non-Lightcloud)
  Indicates non-Lightcloud wired control device. Consult Lightcloud.com for assistance with integration into a Lightcloud system..
- DH - Daylight Harvester (open loop) (1 2 8)
- WD - Wall Box Dimmer/Switch (1 2 3 8 9)
- TS - Touch Screen Wall Display (1 2 4 8)

Lightcloud Notes

1. Wireless ranges vary greatly depending on which materials stand in the way between two devices. For line of sight applications, max device distance is 250 feet. For interior applications, 30 feet between devices is good practice.
2. Avoid placing devices near microwaves, motors, elevator mech rooms or radio antennas to minimize interference with the wireless signal.
3. Neutral wire of the load must be connected to the white-red sense wire in order to measure power use. If the Switched Neutral line cannot be used, it should be tied to the regular neutral wires (i.e. all neutral wires joined).
4. Designed to be hard-wired to AC power. An external readily accessible disconnect device, such as a circuit breaker, is required.
5. Contact RAB only for replacement of Gateway Li-Ion battery. CAUTION! RISK OF EXPLOSION IF BATTERY IS REPLACED BY AN INCORRECT TYPE.
6. Install in location with good cellular signal. Locations with significant concrete and brick construction, or underground locations, are not recommended. DO NOT INSTALL INSIDE METAL ENCLOSURE.
7. Install in dry or non-condensing damp environment only.
8. Must be installed in UL-approved single gang wall-box enclosure. Use only solid copper wire.
9. Indoor use only.
10. Changes or modifications to Lightcloud equipment not expressly approved by RAB Lighting, Inc. may void the user's authority to operate this equipment.

RAB LIGHTING
170 Ludlow Avenue, Northvale, NJ 07647
888 722-1000 • RABWEB.COM

CLIENT:

XXX

REV	DATE	DESCRIPTION	BY
###	MM.DD.YY	PROJECT AWARD DATE	XXX

PROJECT:

XXX

SCALE: AS SHOWN
DATE: XXXXX
CASE NUMBER: XXXXX
DESIGNED BY: CBarnes, LC
DRAWN / CHK BY: SFillion, LC

TITLE:

Lightcloud Application Information - Open Storage Example

DRAWING NUMBER:

EL-7.3

ADVISORY DRAWING SET
NOT FOR CONSTRUCTION

All drawings and representations of the lighting design intent are the copyright property of RAB Lighting, Inc. Reproduction of any and all drawings, specifications, related documents, and design illustrations, in whole or in part, is strictly forbidden without written permission. The Energy Analysis, Visual Simulations, Lighting Analysis, Control Intent documentation, and/or ezLayout, (representing "Lightcloud Documentation") provided by the RAB Lighting Inc. ("RAB") represent an anticipated prediction of lighting system performance based upon design and control parameters and information supplied by others. These design parameters and information provided by others have not been field verified by RAB and therefore actual measured results may vary from the actual field conditions. RAB recommends that design parameters and other information be field verified to reduce variation. RAB neither warranties, either implied or stated with regard to actual measured light levels or energy consumption levels as compared to those illustrated by the Lightcloud Documentation. Additionally the appropriateness, completeness or suitability of the Lightcloud Documentation intent as compliant with any applicable regulatory code requirements with the exception of those specifically stated on drawings created and submitted by RAB. The Lightcloud Documentation is issued, in whole or in part, as advisory documents for informational purposes and is not intended for construction nor as being part of a project's construction documentation package.

C:\Users\catherine.barnes\Desktop\For Rob Riley.dwg



THE LIGHTCLOUD GATEWAY IS RATED 120-277VAC AND CONTAINS AN INTEGRAL JUNCTION BOX FOR HARD-WIRED INSTALLATION BY A QUALIFIED ELECTRICIAN.

Detail 1 — GW - Gateway Wiring Diagram



LED INDICATORS

POWER
GREEN: FULLY POWERED

CELLULAR
OFF: NO OR POOR CELLULAR SIGNAL. YOU MUST MOVE THE GATEWAY TO A LOCATION WITH BETTER CELLULAR SIGNAL.

SOLID YELLOW: ADEQUATE CELLULAR SIGNAL.
THIS SIGNAL STRENGTH WORKS FOR MOST APPLICATIONS,
BUT IF POSSIBLE, MOVE TO A LOCATION WITH BETTER SIGNAL.

SOLID GREEN: GOOD CELLULAR SIGNAL.

SYSTEM STATUS
BLINKING YELLOW: INITIALIZING

SOLID YELLOW: ERROR; CANNOT REACH LIGHTCLOUD SERVICE.
CHECK CELLULAR SIGNAL STRENGTH AND CALL RAB FOR TECHNICAL SUPPORT.

BLINKING GREEN: SETUP MODE ENABLED (ACCEPTING NEW DEVICES)

SOLID GREEN: NORMAL OPERATION

Detail 2 — GW - Gateway Status Indicators

LABELING YOUR DEVICE



DEVICE ID	ZONE NAME	PANEL/CIRCUIT#	DIMMING
0013A200 40B624AA	FRONT DESK	2	✓

Detail 3 — Lightcloud Commissioning Device ID Table



Detail 4 — WD - Wall Dimmer Wiring Diagram



Detail 5 — WD - Wall Dimmer Status Indicators



PLUG IN THE DAYLIGHT DEVICE (SETUP ONLY)
TO JOIN YOUR GATEWAY TO A LIGHTCLOUD NETWORK, PLUG IT WITH THE INCLUDED MICRO USB POWER ADAPTER.
THE DEVICE WILL BLINK YELLOW AS IT JOINS THE NETWORK. ONCE IT JOINS, IT WILL BLINK GREEN AND THEN TURN OFF.
ONCE IT IS JOINED TO YOUR NETWORK, FOR SETUP PURPOSES, YOU CAN PLUG THE DEVICE IN ANYWHERE THAT'S CONVENIENT.
THE DEVICE WILL BLINK GREEN WHEN IT'S READY TO BE CONFIGURED. IF IT BLINKS YELLOW, IT'S NOT READY FOR CONFIGURATION (CONNECTIVITY).
ONCE SETUP HAS BEEN COMPLETED, YOU CAN UNPLUG THE DEVICE AND IT WILL OPERATE EXCLUSIVELY ON SOLAR POWER - NO BATTERIES NECESSARY.

DEVICE STATUS INDICATOR:
SOLID YELLOW: INITIALIZING, INDICATES THAT THE DEVICE IS JOINED TO A LIGHTCLOUD NETWORK AND IS OPERATING NORMALLY.
SOLID GREEN: WHEN POWERED BY USB, INDICATES THAT THE DEVICE IS JOINED TO A LIGHTCLOUD NETWORK.
GREEN BLINK: AFTER PRESSING THE DEVICE BUTTON, INDICATES THAT A LIGHT LEVEL MEASUREMENT HAS BEEN TRANSMITTED.
BLINKING YELLOW: DEVICE IS ATTEMPTING TO JOIN A LIGHTCLOUD NETWORK.
BRIEFLY BLINKING RED: RESET FAILED TO FACTORY DEFAULTS.

USB POWER INDICATOR:
SOLID GREEN: WHEN POWERED BY USB.

DEVICE BUTTON
PRESS AND RELEASE: WHEN PAIRED TO A LIGHTCLOUD APPLICATION AND MEASURE LIGHT LEVEL.
HOLD FOR 10 SECONDS WHILE USB POWERED: FORCE DEVICE TO LEAVE CURRENT LIGHTCLOUD NETWORK.
HOLD FOR 10 SECONDS WHILE CONNECTING USB POWER: RESET TO FACTORY DEFAULTS AND LEAVE CURRENT NETWORK.

Detail 6 — DH - Daylight Harvester Status Indicators

SWITCHED NEUTRAL

THE "SWITCHED NEUTRAL" WHITE WITH RED STRIPE WIRE IS THE NEUTRAL LINE FOR THE LOAD BEING SWITCHED. THIS ENABLES POWER MEASUREMENT. SEE THE POWER MEASUREMENT SECTION UNDER "FUNCTIONALITY" FOR MORE INFORMATION.



Detail 7 — LC - Controller Wiring Diagram

CONFIRM DEVICE CONNECTIVITY

CONFIRM STATUS INDICATOR IS SOLID GREEN (SEE DETAILS BELOW)

DEVICE IDENTIFICATION BUTTON
- ILLUMINATED WHEN DEVICE IS POWERED
- PRESS ONCE TO HIGHLIGHT THIS DEVICE IN THE LIGHTCLOUD APPLICATION
- PRESS TWICE TO TOGGLE CIRCUIT ON AND OFF
- PRESS TWICE AND HOLD TO SET DIM LEVEL
- PRESS AND HOLD FOR 10 SECONDS TO REMOVE THIS DEVICE FROM A LIGHTCLOUD NETWORK
- BLINKS WHEN DEVICE IS INDICATED FROM THE LIGHT CLOUD APPLICATION

SIGNAL INDICATOR
ILLUMINATES WHEN THE DEVICE RECEIVES A MESSAGE AND INDICATES THE STRENGTH OF THE SIGNAL.
3-BEST SIGNAL
2-ACCEPTABLE SIGNAL
1-UNACCEPTABLE SIGNAL
CONSULT THE 'FINDING A LOCATION' SECTION FOR MORE INFORMATION

STATUS INDICATOR
SOLID GREEN WHEN CONNECTED TO YOUR LIGHTCLOUD NETWORK. BLINKING RED WHEN NOT CONNECTED.
THE DEVICE WILL AUTOMATICALLY CONTINUE TRYING TO CONNECT TO A NETWORK IN SETUP MODE.

Detail 8 — LC - Controller Status Indicators

OPERATING MODES

CONTROLLER: PROVIDES SWITCHING AND DIMMING FOR A SINGLE ZONE

TRIGGER: DETECT WHEN AN ATTACHED CIRCUIT IS OPEN OR CLOSED. FOR EXAMPLE, YOU COULD ATTACH THE CONTROLLER IN TRIGGER MODE TO AN EXISTING OCCUPANCY SENSOR TO ALLOW YOUR LIGHTCLOUD SYSTEM TO REACT TO THE SENSOR.



REPEATER: DISABLES ZONE CONTROL AND POWER MEASUREMENT, AND EXTENDS THE RANGE OF YOUR NETWORK.

POWER MEASUREMENT: THE LIGHTCLOUD CONTROLLER IS CAPABLE OF MEASURING THE POWER USAGE OF THE ATTACHED CIRCUIT.
IN ORDER TO UTILIZE THIS FUNCTION, THE NEUTRAL WIRE OF THE LOAD MUST BE CONNECTED TO THE WHITE-RED SENSE WIRE.
IF THE SWITCHED NEUTRAL LINE CANNOT BE USED, IT SHOULD BE TIED TO THE REGULAR NEUTRAL WIRES (I.E. ALL NEUTRAL WIRES JOINED).

POWER LOSS DETECTION: IF POWER TO THE CONTROLLER IS LOST, THE DEVICE WILL DETECT THIS AND ALERT THE LIGHTCLOUD APPLICATION.

EMERGENCY DEFAULT: IF COMMUNICATION IS LOST, THE CONTROLLER MAY OPTIONALLY FALL BACK TO A SPECIFIC STATE, SUCH AS TURNING THE ATTACHED CIRCUIT ON.

Detail 9 — LC - Controller Trigger Mode Wiring

SWITCHED NEUTRAL

THE "SWITCHED NEUTRAL" WHITE WITH RED STRIPE WIRE IS THE NEUTRAL LINE FOR THE LOAD BEING SWITCHED. THIS ENABLES POWER MEASUREMENT. SEE THE POWER MEASUREMENT SECTION UNDER "FUNCTIONALITY" FOR MORE INFORMATION.



Detail 10 — OC - Occupancy/Vacancy Sensor Wiring Diagram



STATUS INDICATOR
SOLID GREEN WHEN CONNECTED TO YOUR LIGHTCLOUD NETWORK.
BLINKING RED WHEN NOT CONNECTED. THE DEVICE WILL AUTOMATICALLY
CONTINUE TRYING TO CONNECT TO A NETWORK IN SETUP MODE.

POWER INDICATOR
ILLUMINATED WHEN POWERED. BLINKING WHEN INDICATED FROM THE LIGHTCLOUD APPLICATION.

SIGNAL INDICATOR
ILLUMINATES WHEN THE DEVICE RECEIVES A MESSAGE AND INDICATES THE STRENGTH OF THE SIGNAL.
3-BEST SIGNAL
2-ACCEPTABLE SIGNAL
1-UNACCEPTABLE SIGNAL
CONSULT THE "FINDING A LOCATION" SECTION FOR MORE INFORMATION

DEVICE BUTTON
- PRESS AND RELEASE TO HIGHLIGHT THIS DEVICE IN THE LIGHTCLOUD APPLICATION
- (PRESSING NOT ALSO ENABLES DISPLAY OF THE SIGNAL INDICATORS).
- PRESS TWICE TO TOGGLE CIRCUIT ON AND OFF
- PRESS TWICE AND HOLD TO SET DIM LEVEL
- PRESS AND HOLD FOR 10 SECONDS TO REMOVE THIS DEVICE FROM A LIGHTCLOUD NETWORK

MOTION INDICATOR
SENSOR WHEN MOTION IS DETECTED
PASSIVE INFRARED MOTION SENSOR

Detail 11 — OC - Occupancy/Vacancy Sensor Status Indicators

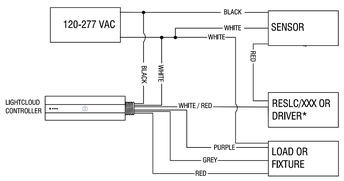

ADVANCED TRIGGER: LIGHTCLOUD CONTROLLERS CAN RECEIVE INPUTS OR TRIGGERS FROM 3RD PARTY SWITCHING DEVICES SUCH AS MOTION OR LIGHT SENSORS.

RESISTANCE: A RESISTOR OR SECOND FIXTURE DRIVER MUST BE USED BETWEEN THE CONTROLLER AND SENSOR. RESLC/120 FOR 120VAC APPLICATIONS OR RESLC/277 FOR 277VAC APPLICATIONS. THE DRIVER MUST ME GREATER THAN 10mA.

INSTALLATION: ANY WIRES NOT IN USE MUST BE CAPPED OFF OR OTHERWISE INSULATED. THIS PRODUCT SHOULD ONLY BE INSTALLED BY A QUALIFIED ELECTRICIAN AND IN COMPLIANCE WITH LOCAL AND NATIONAL ELECTRICAL CODES.

EMERGENCY DEFAULT: IF COMMUNICATION IS LOST, THE CONTROLLER MAY OPTIONALLY FALL BACK TO A SPECIFIC STATE, SUCH AS TURNING THE ATTACHED CIRCUIT ON.

Detail 12 — AT - Advanced Trigger Wiring Diagram

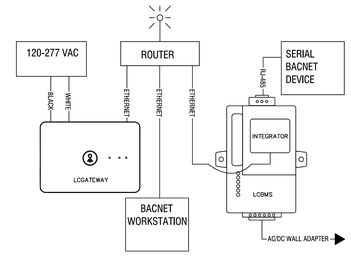

INTEGRATOR: INTEGRATOR INPUT SHALL BE 9-30 VDC OR 12-24 VAC.

GATEWAY: THE GATEWAY SHALL BE HARDWIRED TO A 120V POWER SUPPLY.

INSTALLATION: ANY WIRES NOT IN USE MUST BE CAPPED OFF OR OTHERWISE INSULATED. THIS PRODUCT SHOULD ONLY BE INSTALLED BY A QUALIFIED ELECTRICIAN AND IN COMPLIANCE WITH LOCAL AND NATIONAL ELECTRICAL CODES.

Detail 13 — I - Integrator Wiring Diagram

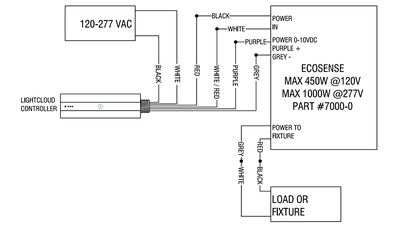

PHASE DIMMING <450W: LIGHTCLOUD CONTROLLERS CAN DIM PHASE LOADS USING A PHASE DIMMING ADAPTER. FOR LOADS LESS THAN 450W @120V AND 1000W @ 277, WE RECOMMEND THE ECOSENSE ECOSPEC ADAPTER.

INSTALLATION: ANY WIRES NOT IN USE MUST BE CAPPED OFF OR OTHERWISE INSULATED. THIS PRODUCT SHOULD ONLY BE INSTALLED BY A QUALIFIED ELECTRICIAN AND IN COMPLIANCE WITH LOCAL AND NATIONAL ELECTRICAL CODES.

Detail 14 — PD - Phase Dimming <450W Wiring Diagram

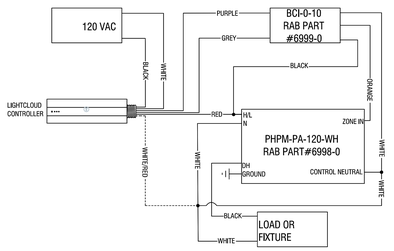

PHASE DIMMING 450W - 1800W: LIGHTCLOUD CONTROLLERS CAN DIM PHASE LOADS USING A PHASE DIMMING ADAPTER. FOR LOADS BETWEEN 450W-1800W, WE RECOMMEND THE LUTRON PHPM-PA-120-WH PHASE DIMMER AND BCI-0-10 BALLAST CONTROL INTERFACE.

RATINGS: PHASE DIMMER: LUTRON PHPM-PA-120-WH, 120V@16A. BALLAST CONTROL INTERFACE: LUTRON BCI-0-10, CONTROL INPUT VOLTAGE: 0-10V; CONTROL INPUT CURRENT: SOURCE 500µA; COMPATIBLE VOLTAGE: 120-277 V ~ 50/60Hz.

INSTALLATION: ANY WIRES NOT IN USE MUST BE CAPPED OFF OR OTHERWISE INSULATED. THIS PRODUCT SHOULD ONLY BE INSTALLED BY A QUALIFIED ELECTRICIAN AND IN COMPLIANCE WITH LOCAL AND NATIONAL ELECTRICAL CODES.

Detail 15 — PD - Phase Dimming 450-1800W Wiring Diagram

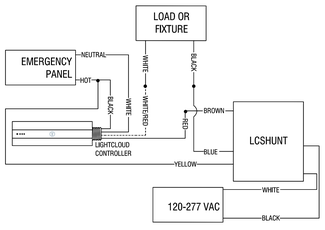

EMERGENCY SHUNT ON/OFF: LIGHTCLOUD CONTROLLER EMERGENCY FIXTURE WIRING WITH LCSHUNT FOR ON/OFF OPERATION ONLY.

RATINGS: THE LCSHUNT INCLUDES A 20A RATED HIGH VOLTAGE FORM C (N/O & N/C) RELAY AND IS UL924 LISTED FOR EMERGENCY LIGHTING CONTROL APPLICATIONS. THE LCSHUNT CAN BYPASS A LINE VOLTAGE SWITCH OR DIMMER, ENSURING THAT AN EMERGENCY FIXTURE ILLUMINATES AT FULL BRIGHTNESS DURING A UTILITY POWER INTERRUPTION.

INSTALLATION: ANY WIRES NOT IN USE MUST BE CAPPED OFF OR OTHERWISE INSULATED. THIS PRODUCT SHOULD ONLY BE INSTALLED BY A QUALIFIED ELECTRICIAN AND IN COMPLIANCE WITH LOCAL AND NATIONAL ELECTRICAL CODES.

Detail 16 — UL - UL924 Relay On-Off Wiring Diagram

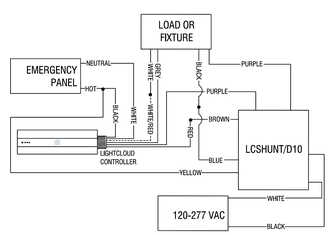

EMERGENCY SHUNT DIMMING: LIGHTCLOUD CONTROLLER EMERGENCY FIXTURE WIRING WITH LCSHUNT/DIM FOR ON/OFF AS WELL AS 0-10V DIMMING OPERATION.

RATINGS: THE LCSHUNT/D10 INCLUDES A 20A RATED HIGH VOLTAGE FORM C (N/O & N/C) RELAY AND IS UL924 LISTED FOR EMERGENCY LIGHTING CONTROL APPLICATIONS. THE LCSHUNT/D10 CAN SIMULTANEOUSLY BYPASS A LINE VOLTAGE SWITCH OR DIMMER, ENSURING THAT AN EMERGENCY FIXTURE ILLUMINATES AT FULL BRIGHTNESS DURING A UTILITY POWER INTERRUPTION.

INSTALLATION: ANY WIRES NOT IN USE MUST BE CAPPED OFF OR OTHERWISE INSULATED. THIS PRODUCT SHOULD ONLY BE INSTALLED BY A QUALIFIED ELECTRICIAN AND IN COMPLIANCE WITH LOCAL AND NATIONAL ELECTRICAL CODES.

Detail 17 — UL - UL924 Relay On-Off / Dimming Wiring Diagram

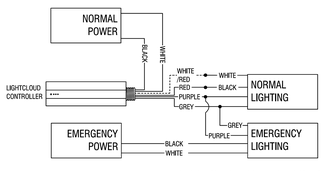

EMERGENCY AND NORMAL INTERCONNECT: LIGHTCLOUD CONTROLLERS CAN BE USED TO CONTROL EMERGENCY LIGHTING FED WITH "ALWAYS ON" EMERGENCY POWER. UPON LOSS OF POWER, EMERGENCY LIGHTING WILL FAIL TO "FULL ON" LIGHT OUTPUT.

NOTE: IN SPACES WHERE THERE IS ONLY ONE LUMINAIRE, AND IT IS CONNECTED TO EMERGENCY POWER, THE CONTROLLER WILL NEED TO BE CONNECTED TO A NORMAL POWER CIRCUIT FOR PROPER OPERATION. EMERGENCY FIXTURES WITH ON-BOARD BATTERY BACKUP DO NOT REQUIRED SPECIAL WIRING.

INSTALLATION: ANY WIRES NOT IN USE MUST BE CAPPED OFF OR OTHERWISE INSULATED. THIS PRODUCT SHOULD ONLY BE INSTALLED BY A QUALIFIED ELECTRICIAN AND IN COMPLIANCE WITH LOCAL AND NATIONAL ELECTRICAL CODES.

Detail 18 — EM - Emergency / Normal Interconnect Wiring Diagram

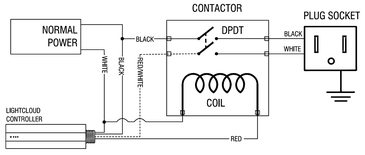

PLUG LOAD CONTROL: LIGHTCLOUD CONTROLLERS CAN BE USED TO CONTROL POWER TO RECEPTACLES THROUGH A CONTACTOR. CONTACTOR BY OTHERS.

INSTALLATION: ANY WIRES NOT IN USE MUST BE CAPPED OFF OR OTHERWISE INSULATED. THIS PRODUCT SHOULD ONLY BE INSTALLED BY A QUALIFIED ELECTRICIAN AND IN COMPLIANCE WITH LOCAL AND NATIONAL ELECTRICAL CODES.

Detail 19 — Lightcloud Plug Load Control Wiring Diagram

ADVISORY DRAWING SET
NOT FOR CONSTRUCTION

All drawings and representations of the lighting design intent are the copyright property of RAB Lighting, Inc. Reproduction of any and all drawings, specifications, related documents, and design illustrations, in whole or in part, is strictly forbidden without written permission. The Energy Analysis, Visual Simulations, Lighting Analysis, Control Intent documentation, and/or ezLayout, (representing "Lightcloud Documentation") provided by the RAB Lighting Inc. ("RAB") represent an anticipated prediction of lighting system performance based upon design and control parameters and information supplied by others. These design parameters and information provided by others have not been field verified by RAB and therefore actual measured results may vary from the actual field conditions. RAB recommends that design parameters and other information be field verified to reduce variation. RAB neither warranties, either implied or stated with regard to actual measured light levels or energy consumption levels as compared to those illustrated by the Lightcloud Documentation. Additionally the appropriateness, completeness or suitability of the Lightcloud Documentation intent as compliant with any applicable regulatory code requirements with the exception of those specifically stated on drawings created and submitted by RAB. The Lightcloud Documentation is issued, in whole or in part, as advisory documents for informational purposes and is not intended for construction nor as being part of a project's construction documentation package.

RAB LIGHTING
170 Ludlow Avenue, Northvale, NJ 07647
888 722-1000 • RABWEB.COM

CLIENT:

XXX

REV #	DATE MM.DD.YY	DESCRIPTION PROJECT AWARD DATE	BY
			XXX

PROJECT:

XXX

SCALE:	AS SHOWN
DATE:	XXX
CASE NUMBER:	XXX
DESIGNED BY:	CBarnes, LC
DRAWN / CHK BY:	SFillion, LC

TITLE:

Wiring Diagrams

DRAWING NUMBER:

EL-7.4

C:\Users\catherine.barnes\Desktop\For Rob Rilley.dwg

Installing a Lightcloud® System

1 Step One

Position the Gateway

a. Avoid Problem Materials and Devices.

Don't place the Gateway in a metal enclosure, thick concrete or brick rooms. Also don't place the Gateway near microwaves, elevator rooms, amplifiers, or other antennas.

Problem Materials

Problem Devices & Signals

Microwaves

Elevator Mechanical Rooms

Amplifiers & Antennas

b. Choose a location that is as close to as many other Lightcloud devices as possible.

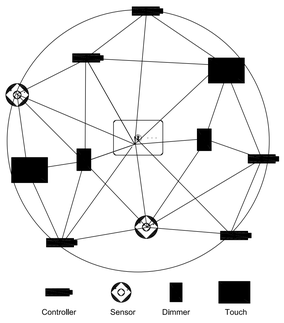

**All of the devices don't have to be within a 100' of the Gateway 4G, but it's ideal to have as many within direct range as possible.*

c. Test the cellular signal.

Plug in the Gateway and check the cellular signal strength.
The cellular signal strength LED should be solid green.
Yellow is also adequate but not ideal.
If the cellular signal strength LED is off, move the Gateway to a new location and test again.

2 Step Two

Record the Gateway's Device ID

Each Lightcloud device has a unique Device ID for identification that needs to be documented. To document the Device IDs, use one of the following 3 methods.

a. LC Installer App - Free

Scan Device IDs and send information to RAB
Download: lightcloud.com/lcinstaller (Available for iOS and Android)



b. Device Table - Included with the Gateway and Lighting Schedule

Attach Device ID stickers to Device Table and complete information.
Send detailed photos of completed device table to support@lightcloud.com.

Additional Device Tables can be downloaded at: lightcloud.com/devicetable



c. Floor Plan

Attach the Device Identification sticker to its location on a floor plan, lighting design, or design schedule. Send detailed photos of completed plans to support@lightcloud.com.

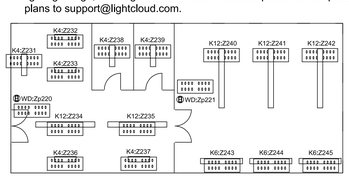

3 Step Three

Permanently Install the Gateway

a. Mount the Gateway to the wall.
b. Wire the Gateway for line power.

4 Step Four

Install and Document the Other Lightcloud Devices

a. Follow the Device Manuals to wire the other devices for permanent, unswitched power.

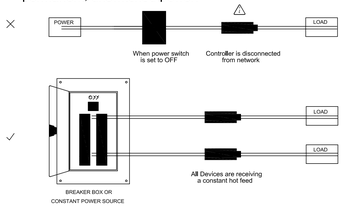

b. As you wire each device, document their Device IDs using the same method you chose to document the Gateway's Device ID in step 3.

5 Step Five

Submit Device Information

After wiring and organizing all of the devices, submit the device information using the lc installer app or email photos of the documented device ids to *Support@lightcloud.com.*

6 Step Six

You're Done!

Lightcloud support will remotely configure the system.

Note: Don't Leave The Job-site Until Lightcloud Support Has Verified That All Of The Devices Have Joined The Network And Have Been Properly Documented.

Installation Checklist

Gateway

- □ Gateway has cellular reception.
- □ Gateway is located centrally to other Lightcloud Devices.
- □ Gateway is installed to permanent, constant power.
- □ Gateway is free from locations with heavy interference.
- □ Gateway is in an unobstructed location.
- □ Gateway's Device ID has been recorded.

Controller Sensor Dimmer Touch

- □ Device is within range of one or more Lightcloud Devices.
- □ Device is wired to permanent, constant power.
- □ Device is free from locations with heavy interference.
- □ Device is in an unobstructed location.
- □ Device ID has been recorded.

Device Table

Site Name:
Site Address:

DEVICE ID	ZONE NAME	AREA/ROOM	CIRCUIT	DIM	PWR/ENGY	NOTES
	GATEWAY					